


### Module Mounting Locations

The IPS-4848DS Programmable Input Switches Module mounts into a series of enclosures as part of the fire alarm system. This adder module provides 48 programmable switches, 48 bi-coloured (red/amber) LEDs for fire alarm zone annunciation and 48 amber trouble LEDs.

**Figure 1: IPS-4848DS Programmable Input Switches Module Front Chassis View**



**Figure 2: IPS-4848DS CABLE CONNECTIONS**

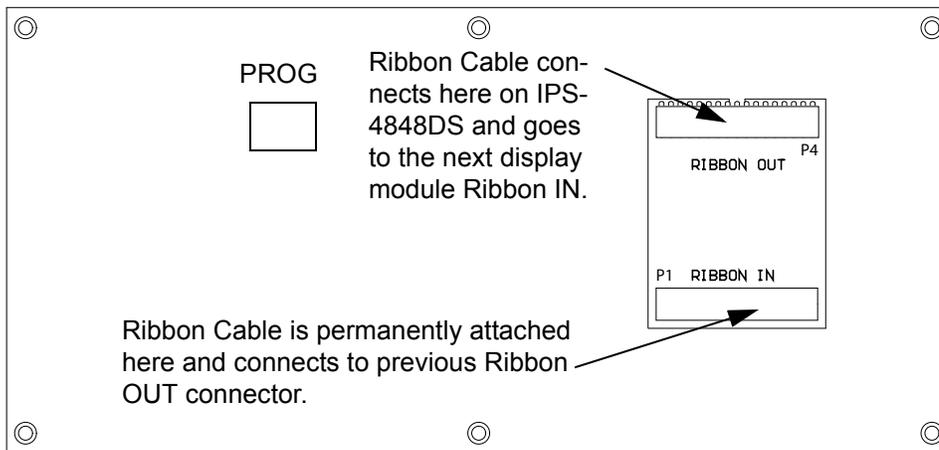

Refer to the fire alarm manual for further information regarding the IPS-4848DS

### NOTICE TO USERS, INSTALLERS, AUTHORITIES HAVING JURISDICTION, AND OTHER INVOLVED PARTIES

This product incorporates field-programmable software. In order for the product to comply with the requirements in the Standard for Control Units and Accessories for Fire Alarm Systems, UL 864 and the Standard for Control Units for Fire Alarm Systems, CAN/ULC-527-11, certain programming features or options must be limited to specific values or not used at all as indicated below.

Program feature or option	Permitted in UL 864, CAN/ULC-S527? (Y/N)	Possible settings	Settings permitted in UL 864, CAN/ULC-S527
IPS-4848DS Zone Switch Alarm	N	Resound by pressing Signal Silence button again	Same button can be used to resound the signals after they have been silenced