



## Description

Mircom's BPS-602 is an extremely cost effective 6.5 amp voltage regulated remote power supply/battery charger. It may be connected to any 12 or 24 volt Fire Alarm Control Panel (FACP). Primary applications include Notification Appliance Circuit (NAC such as strobes and horns) expansion support to meet ADA requirements. It also provides auxiliary power to support system accessories. The unit delivers regulated and filtered 24 or 12 volt power to Class B or Class A NAC loop circuits.

Additionally, a separate 1.0A auxiliary output with reset for four (4)-wire smoke detectors is available. The 6.5 amp rated supply current can be divided between the four (4) outputs for powering NAC devices. Each output is rated at 2.5 amp max., and can be independently programmed for Steady, Temporal Code 3 or Strobe Synchronization. All outputs may be programmed for Input to Output Follower Mode (output will follow input. i.e. March Time Input, March Time Output). An individual output of 4 amp is achieved by paralleling 2 outputs.

The BPS-602 in non-alarm condition independent loop supervision for Class A and/or Class B FACP NAC circuits is provided. In the event of a loop trouble the FACP will be notified via the steered input (input 1 or input 2). In addition, there are common trouble output terminals (N.C., C, N.O.) which are used to indicate general loop/system trouble. A common trouble input is provided for optional NC (normally closed) devices to report trouble to the FACP. Two (2) FACP signaling outputs can be employed and directed to control supervision and power delivery to any combination of the four (4) outputs. The unit also features "Loop Output" trouble memory indication to help identify trouble some sporadic problems.

## Features

- Power input 115VAC 60 Hz, 1.45 amp.
- Two (2) Class A or two (2) Class B FACP inputs
- Field selectable 24VDC or 12VDC voltage regulated power limited outputs
- 24VDC or 12VDC rated @ 6.5 amp max total alarm current
- 2.5 amp max current per output
- Separate 1 Amp auxiliary output with built-in and remote reset capability
- Two (2) outputs may be paralleled for more power on an indicating circuit
- Programmable supervised indicating circuit outputs: Up to Four (4) Class B or Two (2) Class A or One (1) Class A and Two (2) Class B Thermal and short circuit protection with auto reset
- Built-in charger for sealed lead acid or gel type batteries
- Automatic switchover to stand-by battery when AC Fails
- Zero voltage drop when switching over to battery backup
- PTC battery protection
- AC fail supervision (form "C" contact, 1 amp / 28VDC). Factory set for 1 minute with optional 18 hour delay setting (field selectable)
- Battery presence and low battery supervision (form "C" contact, 1 amp / 28VDC)
- Input and output status LED indicators
- 2 wire horn/strobe Sync mode allows audible notification appliances (horns) to be silenced while visual notification appliances (strobes) continue to operate
- Temporal Code 3, Steady Mode, Input to Output Follower Mode (maintains synchronization of notification appliances circuit)
- Horn/Strobe sync protocols include Mircom, Amseco, Gentex, System Sensor, Faraday and Wheelock
- March Time
- Compatible with 12 or 24VDC fire panels.
- Filtered and electronically regulated output
- Output loop supervision steered to input 1 or input 2
- Common trouble input and output
- Ground fault detection
- Unit includes power supply, red enclosure, cam lock, open frame transformer and battery leads



S5434



7315-1477:148

**MEA**  
approved

220 95E-14

CATALOG NUMBER

**5665**

NOT TO BE USED FOR INSTALLATION PURPOSES.

Mircom reserves the right to make changes at any time without notice in prices, colours, materials, components, equipment, specifications and models and also to discontinue models.

## Power Supply Specifications


<b>AC Input</b>	115VAC / 1.45 amp @ 60Hz
<b>Output</b>	12 - 24VDC. Maximum 2.5 amp per output Total of 6.5 amp in Alarm Condition
<b>Battery</b>	For 12VDC operation use a 12VDC / 12AH battery For 24VDC operation use two (2) 12VDC / 12AH or two (2) 12VDC / 7AH batteries connected in series
<b>Stand-by/Alarm Current:</b>	75mA/150mA
<b>EOL Resistor (end of line)</b>	2.2K (2200 ohm)

## Standby Specifications

Standby Batteries	Standby Time	Alarm Output Total Amp/Minutes	Aux Output Current
24VDC/12AH (use two (2) 12VDC batteries in series)	24 Hours	6.5 amp/15 Minutes	50mA
	60 Hours	6.5 amp/5 Minutes	-
24VDC/7AH	24 Hours	6.5 amp/5 Minutes	-
12VDC/12AH	24 Hours	6.5 amp/15 Minutes	50mA
	60 Hours	6.5 amp/5 Minutes	-
24VDC/36AH Battery	24 Hours	6.5 amp/15 Minutes	1 amp
12VDC/36AH Battery	24 Hours	6.5 amp/15 Minutes	1 amp

## Enclosure Dimensions

15.5"H x 12"W x 4.5"D

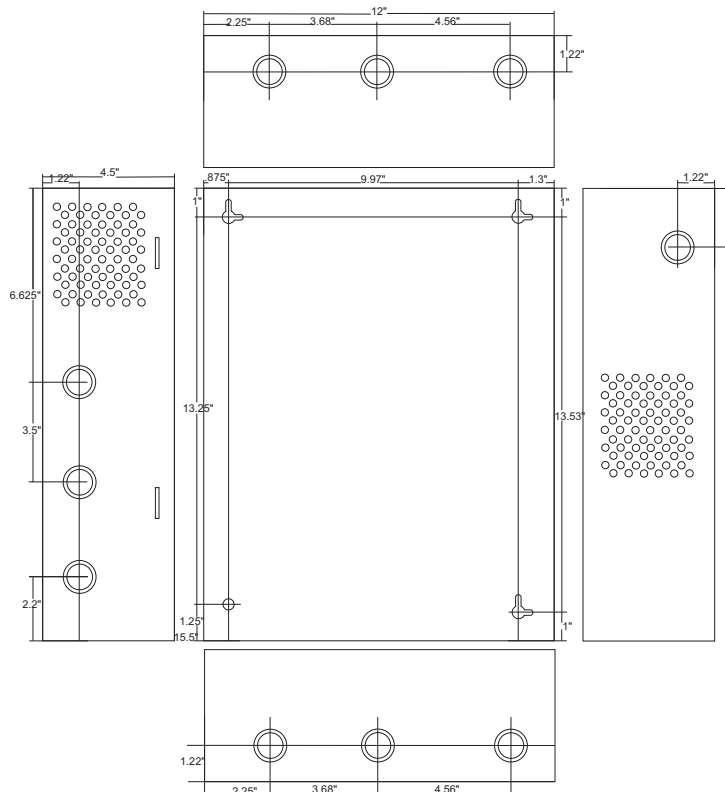

## Ordering Information

Model	Description
BPS-602	6.5 Amp Remote Power Supply

NOT TO BE USED FOR INSTALLATION PURPOSES.



**Canada**  
25 Interchange Way  
Vaughan, Ontario L4K 5W3  
Telephone: (905) 660-4655  
Fax: (905) 660-4113

**U.S.A.**  
4575 Witmer Industrial Estates  
Niagara Falls, NY 14305  
Toll Free: (888) 660-4655  
Fax Toll Free: (888) 660-4113

Web page: <http://www.mircom.com> Email: [mail@mircom.com](mailto:mail@mircom.com)

Distributed by:

ISO 9001:2008  
REGISTERED



CAT. 5665  
Rev. 2