



Description

Mircom's 220VAC 50/60Hz, 2.5 amp is an extremely cost effective 10 amp voltage regulated remote power supply/battery charger. It may be connected to any 12 or 24 volt Fire Alarm Control Panel (FACP). Primary applications include Notification Appliance Circuit (NAC such as strobes and horns) expansion support to meet ADA requirements. It also provides auxiliary power to support system accessories. The unit delivers regulated and filtered 24 volt power to Class B or Class A NAC loop circuits.

Additionally, a separate 1.0A auxiliary output with reset for four (4)-wire smoke detectors is available. The 10 amp max. alarm current can be divided between the four (4) outputs for powering NAC devices. Each output is rated at 2.5 amp max., and can be independently programmed for Steady, Temporal Code 3 or Strobe Synchronization. All outputs may be programmed for Input to Output Follower Mode (output will follow input. i.e. March Time Input, March Time Output). An individual output of 4 amp is achieved by paralleling 2 outputs.

The BPS-1002 in non-alarm condition provides independent loop supervision for Class A and/or Class B FACP NAC circuits. In the event of a loop trouble, the FACP will be notified via the steered input (input 1 or input 2). In addition, there are common trouble output terminals (N.C., C, N.O.) which are used to indicate general loop/system trouble. A common trouble input is provided for optional NC (normally closed) devices to report trouble to the FACP. Two (2) FACP signaling outputs can be employed and directed to control supervision and power delivery to any combination of the four (4) outputs. The unit also features "Loop Output" trouble memory indication to help identify trouble some sporadic problems.

Features

- Power input 115VAC 60 Hz, 4.4 amp., 220VAC 50/60Hz, 2.5 amp.
- Two (2) Class A or two (2) Class B FACP inputs
- Field selectable 24VDC or 12VDC voltage regulated power limited outputs
- Two (2) NC dry contact trigger inputs
- 24VDC @10 amp max total alarm current
- 2.5 amp max current per output
- Separate 1 Amp auxiliary output with built-in and remote reset capability
- Two (2) outputs may be paralleled for more power on an indicating circuit
- Programmable supervised indicating circuit outputs: Up to Four (4) Class B or Two (2) Class A or One (1) Class A and Two (2) Class B Thermal and short circuit protection with auto reset
- Built-in charger for sealed lead acid or gel type batteries
- Automatic switchover to stand-by battery when AC Fails
- Zero voltage drop when switching over to battery backup
- PTC battery protection
- AC fail supervision (form "C" contact, 1 amp / 28VDC). Factory set for 1 minute with optional 18 hour delay setting (field selectable)
- Battery presence and low battery supervision (form "C" contact, 1 amp / 28VDC)
- Input and output status LED indicators
- 2 wire horn/strobe Sync mode allows audible notification appliances (horns) to be silenced while visual notification appliances (strobes) continue to operate
- Temporal Code 3, Steady Mode, Input to Output Follower Mode (maintains synchronization of notification appliances circuit)
- Horn/Strobe sync protocols include Mircom, Amseco, Gentex, System Sensor, Faraday and Wheelock
- March Time
- Compatible with 12 or 24VDC fire panels.
- Filtered and electronically regulated output
- Output loop supervision steered to input 1 or input 2
- Common trouble input and output
- Ground fault detection
- Unit includes power supply, red enclosure, cam lock, open frame transformer and battery leads



S5434



7315-1477:146



385-05-E

Specifications


AC Input	115VAC / 4.4 amp @ 60Hz, 220VAC 50/60Hz, 2.5 amp
Output	24VDC. Maximum 2.5 amp per output Total of 10 amp in Alarm Condition
Battery	For 12VDC operation use a 12VDC / 12AH battery For 24VDC operation use two (2) 12VDC / 12AH or two (2) 12VDC / 7AH batteries connected in series
Stand-by/Alarm Current:	90mA/175mA
EOL Resistor (end of line)	2.2K (2200 ohm)

Standby Specifications

Standby Batteries	Standby Time	Alarm Output Total Amp/Minutes	Aux Output Current
24VDC/12AH (use two (2) 12VDC batteries in series)	24 Hours	10 amp/15 Minutes	50mA
	60 Hours	10 amp/5 Minutes	-
24VDC/7AH	24 Hours	10 amp/5 Minutes	-
24VDC/36AH Battery	24 Hours	10 amp/15 Minutes	1 amp
12VDC/36AH Battery	24 Hours	10 amp/15 Minutes	1 amp

Enclosure Dimensions

15.5"H x 12"W x 4.5"D

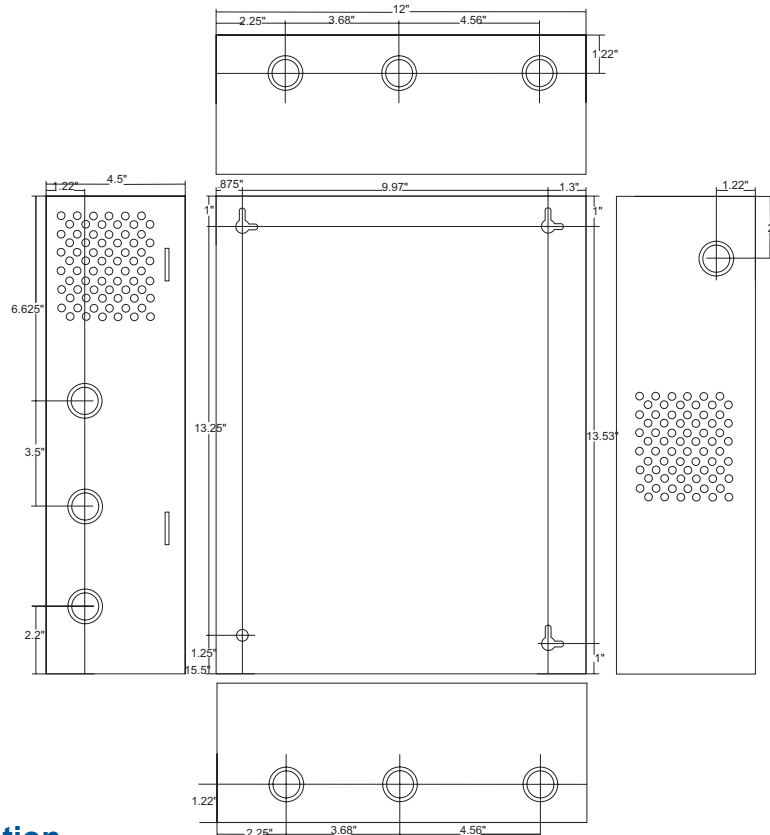

Ordering Information

Model	Description
BPS-1002	10 Amp Remote Power Supply
BPS-1002/220	10 Amp Remote Power Supply 220V



Canada
25 Interchange Way
Vaughan, Ontario L4K 5W3
Telephone: (905) 660-4655
Fax: (905) 660-4113

U.S.A.
4575 Witmer Industrial Estates
Niagara Falls, NY 14305
Toll Free: (888) 660-4655
Fax Toll Free: (888) 660-4113



THIS INFORMATION IS FOR MARKETING PURPOSES ONLY AND NOT INTENDED TO DESCRIBE THE PRODUCTS TECHNICALLY.

For complete and accurate technical information relating to performance, installation, testing and certification, refer to technical literature. This document contains intellectual property of Mircom. The information is subject to change by Mircom without notice. Mircom does not represent or warrant correctness or completeness.