

Limited Warranty

In no event shall Mircom be liable for any direct, indirect or consequential damages, loss of anticipated profits, loss of time or any other losses incurred by the buyer in connection with the purchase, installation or operation or failure of this product.

Important!

Mircom recommends that the entire system be completely tested on a regular basis. However, despite frequent testing and due to but not limited to, criminal tampering or electrical disruption, it is possible for this product to fail to perform as expected.



LT-2031MIR Rev. 0

Canada

25 Interchange Way
Vaughan, ON, L4K 5W3
Tel: (888) 660-4655
Fax: (888) 660-4113
www.mircom.com

USA

60 Industrial Parkway
Cheektowaga, NY, 14227
Tel: (888) 660-4655
Fax: (888) 660-4113

INSTALLATION INSTRUCTIONS



PR-2200 Reverse Polarity/ Municipal Box Module

The PR-2200 Reverse Polarity/Municipal Box Module is jumper programmable for polarity reversal operation or Municipal Box operation, Single or Separate Alarm and AC Fail delay.

Parts List

- Qty 1 ... PR-2200 module
- Qty 4 ... KEP nuts, 4 spacers
- Qty 1 ... 4 pin polarized locking cable assembly
- Qty 6 ... Jumpers (on PCB)

Specifications

Module Specifications

- Standby... 20mA
- Alarm ... Municipal Box Mode = 250mA momentary
- Alarm ... Reverse Polarity Mode = 35mA + load on relay (10mA each)

Municipal Box Output (for use with local energy type (series) master box)

- Maximum Voltage ... 28VDC
- Supervisory Current ... 2mA
- Power Limited Output
- Trip Current ... 1 second momentary @ 250mA (subtracted from AUX power)
- Maximum Wire & Coil Resistance ... 20Ω total

Reverse Polarity Outputs

- Maximum Voltage ... 28VDC
- Maximum Current ... 10mA
- Power Limited ... Yes
- Maximum Loop Resistance ... 2200Ω

NOTE: This component must be included in the control panel battery calculation. Refer to the Standby Battery Calculation Sheet included with the control panel.

Installing the PR-2200 Module

The PR-2200 module mounts on 4 threaded studs located in the FX-2200 Fire Alarm Control Unit panel. Refer to Figures 1, 2 & Table 1.

1. Configure Jumpers for desired operating modes.
2. Insert spacers on studs.
3. Position the PR-2200 Module on the 4 threaded studs. Secure the module to the studs with 4 KEP nuts (provided).
4. Insert the 4-wire Secur-Bus connector into the RPMB Dialer connector located on the FX-2200 Fire Alarm Unit Control board.
5. Route 14-18 AWG Hookup Wire through the panel access holes in accordance with local regulations. Secure wire connections to output terminals as required.
6. Refer to FX-2200 *Installation Manual* for programming details.


PR-2200 Reverse Polarity/ Municipal Box Module

LED Label	Function
WDOG	Flashes when module is active.
DIS	Active when disconnect switch has been activated.
M-BOX	Active when there is an open circuit on that output (when M-BOX option is enabled).
BUS	Turns on when communications stops between module and panel.
ALM, SUP, TRB	Not used.
PWR	Not used.

Action	Function
Press	Activates test lamp.
Press & hold	Activates disconnect mode (LED activates)

When servicing the panel or module, activating the disconnect switch disables the outputs so that no false data will be sent to the receiving station.

Fig 1 PR-2200 Reverse Polarity/Municipal Box Module

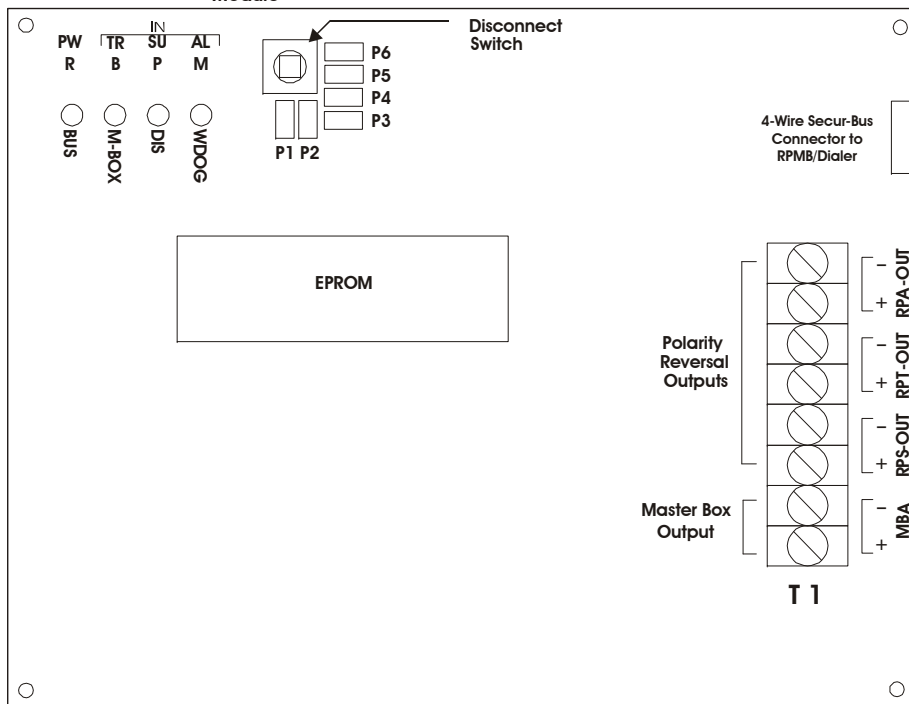

Option	Jumper Settings	Function
AC Delay	P1 P2	NO AC fail delay 6 Hr AC fail delay 12 Hr AC fail delay 24 Hr AC fail delay
	Off Off	
	On Off	
	Off On	
Module Configuration	P3 - Off	Municipal Box Output enabled - Polarity Reversal disabled
	P3 - On	Polarity Reversal enabled - Municipal Box Output disabled
Polarity Reversal Output Options	P4 P5 P6	During an Alarm event the Alarm output reverses polarity During a Supervisory event the Supervisory output reverses polarity During a Trouble event the Trouble output reverses polarity During an Alarm event the Alarm output reverses polarity During a Supervisory event the Alarm output disconnects (no voltage) During a Trouble event the Trouble & Supervisory outputs do not change states During an Alarm event the Alarm output reverses polarity During a Supervisory event the Alarm output disconnects During a Trouble event the Alarm output disconnects, the Trouble & Supervisory outputs do not change states During an Alarm event the Alarm output reverses polarity During a Supervisory event the Supervisory output reverses polarity During a Trouble event the Trouble output does not change states During an Alarm event the Alarm Output reverses polarity During a Supervisory event the Supervisory output reverses polarity During a Trouble event the Alarm and Supervisory outputs are disconnected, the Trouble output does not change states
	On Off Off	
	Off Off Off	
	Off Off On	
	Off On Off	
	Off On On	

Fig 2 FX-2200 Fire Panel Layout

