



Mircom's MS-400 Series Manual Stations provide manual fire reporting. The MS-400 Series manual stations are noncoded, single or double action devices which initiate an alarm when pulled. The MS-400 Series manual stations are constructed of durable aluminium and finished in red enamel paint. An abrasion resistant label with large, raised letters provides clear legible instructions. Models MS-405 and MS-407 are both single stage manual stations. The MS-405 has an additional N.O. switch while the MS-407 has an additional N.C. switch.

MS-405(U) Wiring

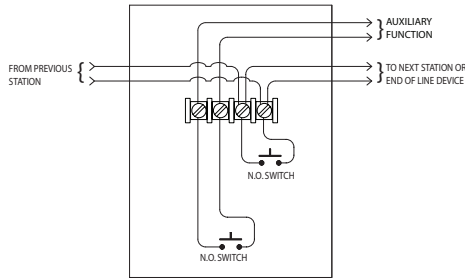

MS-407(U) Wiring

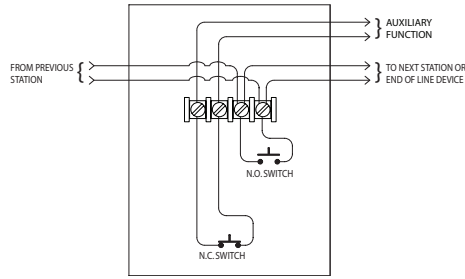

Notes:

1. Wire as shown so that supervision of connections is maintained.
3. Mount station to 2" x 4" x 2 1/4" outlet box.
4. Maximum size: No. 12 AWG.
5. Switches shown in the Station Closed position
6. The suffix "U" denotes USA version.

Models

MS-405(U): Single Stage Manual Station with additional N.O. Switch
MS-407(U): Single Stage Manual Station with additional N.C. Switch


Specifications

Switch Rating: 1 Amp @ 30 VDC
 0.1 Amp @ 120VAC
Surface-Mount Backbox: 2" x 4" x 2 1/4"


All manual fire alarm stations shall be installed as per the specific requirements outlined in the UL codes, as well as all other applicable national or local codes. Final acceptance is subject to the local authority having jurisdiction.

Mircom's MS-400 Series Manual Stations provide manual fire reporting. The MS-400 Series manual stations are noncoded, single or double action devices which initiate an alarm when pulled. The MS-400 Series manual stations are constructed of durable aluminium and finished in red enamel paint. An abrasion resistant label with large, raised letters provides clear legible instructions. Models MS-405 and MS-407 are both single stage manual stations. The MS-405 has an additional N.O. switch while the MS-407 has an additional N.C. switch.

MS-405(U) Wiring

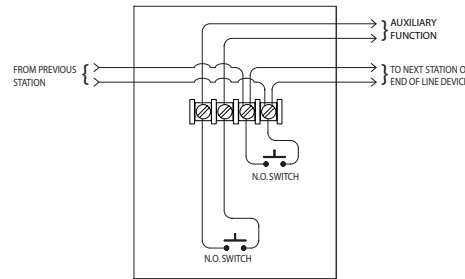

MS-407(U) Wiring

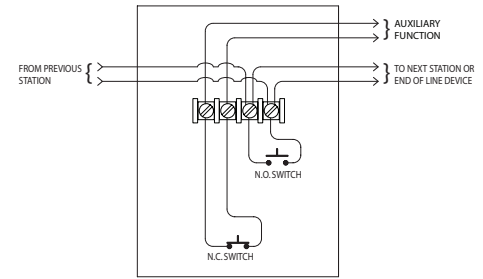

Notes:

1. Wire as shown so that supervision of connections is maintained.
3. Mount station to 2" x 4" x 2 1/4" outlet box.
4. Maximum size: No. 12 AWG.
5. Switches shown in the Station Closed position
6. The suffix "U" denotes USA version.

Models

MS-405(U): Single Stage Manual Station with additional N.O. Switch
MS-407(U): Single Stage Manual Station with additional N.C. Switch


Specifications

Switch Rating: 1 Amp @ 30 VDC
 0.1 Amp @ 120VAC
Surface-Mount Backbox: 2" x 4" x 2 1/4"


All manual fire alarm stations shall be installed as per the specific requirements outlined in the UL codes, as well as all other applicable national or local codes. Final acceptance is subject to the local authority having jurisdiction.

Mircom's MS-400 Series Manual Stations provide manual fire reporting. The MS-400 Series manual stations are noncoded, single or double action devices which initiate an alarm when pulled. The MS-400 Series manual stations are constructed of durable aluminium and finished in red enamel paint. An abrasion resistant label with large, raised letters provides clear legible instructions. Models MS-405 and MS-407 are both single stage manual stations. The MS-405 has an additional N.O. switch while the MS-407 has an additional N.C. switch.

MS-405(U) Wiring

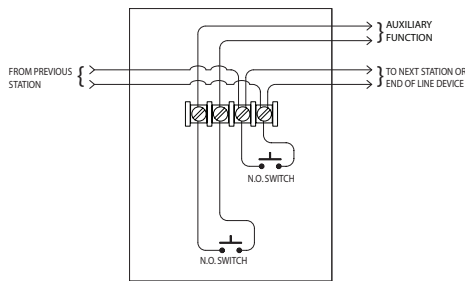

MS-407(U) Wiring

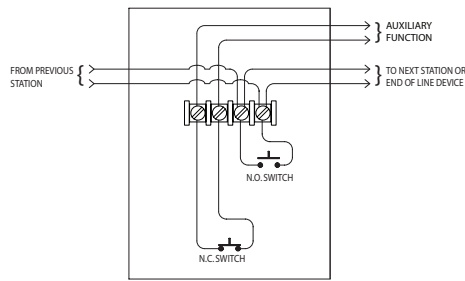

Notes:

1. Wire as shown so that supervision of connections is maintained.
3. Mount station to 2" x 4" x 2 1/4" outlet box.
4. Maximum size: No. 12 AWG.
5. Switches shown in the Station Closed position
6. The suffix "U" denotes USA version.

Models

MS-405(U): Single Stage Manual Station with additional N.O. Switch
MS-407(U): Single Stage Manual Station with additional N.C. Switch


Specifications

Switch Rating: 1 Amp @ 30 VDC
 0.1 Amp @ 120VAC
Surface-Mount Backbox: 2" x 4" x 2 1/4"


All manual fire alarm stations shall be installed as per the specific requirements outlined in the UL codes, as well as all other applicable national or local codes. Final acceptance is subject to the local authority having jurisdiction.

Mircom's MS-400 Series Manual Stations provide manual fire reporting. The MS-400 Series manual stations are noncoded, single or double action devices which initiate an alarm when pulled. The MS-400 Series manual stations are constructed of durable aluminium and finished in red enamel paint. An abrasion resistant label with large, raised letters provides clear legible instructions. Models MS-405 and MS-407 are both single stage manual stations. The MS-405 has an additional N.O. switch while the MS-407 has an additional N.C. switch.

MS-405(U) Wiring

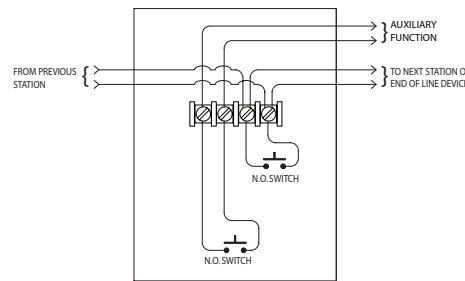

MS-407(U) Wiring

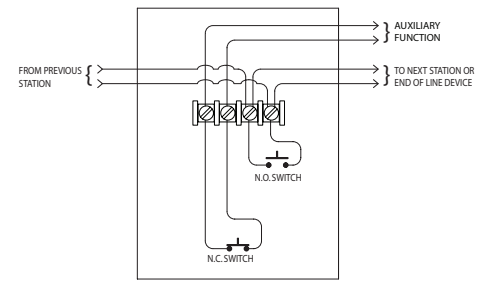

Notes:

1. Wire as shown so that supervision of connections is maintained.
3. Mount station to 2" x 4" x 2 1/4" outlet box.
4. Maximum size: No. 12 AWG.
5. Switches shown in the Station Closed position
6. The suffix "U" denotes USA version.

Models

MS-405(U): Single Stage Manual Station with additional N.O. Switch
MS-407(U): Single Stage Manual Station with additional N.C. Switch

Specifications

Switch Rating: 1 Amp @ 30 VDC
 0.1 Amp @ 120VAC
Surface-Mount Backbox: 2" x 4" x 2 1/4"

All manual fire alarm stations shall be installed as per the specific requirements outlined in the UL codes, as well as all other applicable national or local codes. Final acceptance is subject to the local authority having jurisdiction.