

INSTALLATION AND MAINTENANCE INSTRUCTIONS MIX-4046 MULTI-USE OUTPUT MODULE

25 Interchange way, Vaughan Ontario. L4K 5W3 Phone: 905.660.4655; Fax: 905.660.4113 Web: www.mircomgroup.com

ABOUT THIS MANUAL


This manual is included as a quick reference for installation. For further information on the use of this device with a FACP, please refer to the panel's manual.

Note: This manual should be left with the owner/operator of this equipment.

MODULE DESCRIPTION

The MIX-4046 Output module is designed to operate with a listed compatible intelligent fire system control panel. This module can control speakers, NACs or Fire-Phones. Selection of which mode the module will operate in is made through the panel configuration tool. The module is compatible with FT-300A and FH-100A Fire-Phones and supervision/busy tone on is provided for off-hook handset. The module supports one output circuit, rated at 2A @ 24VDC/25VRMS or 0.5A at 70VRMS, configured as Class A or Class B. An internal EOL resistor is provided for Class A operation. The module supports group activation capability for fast reaction time. The address of each module is set using the MIX-4090 programmer tool and up to 240 units may be installed on a single loop. The module has a panel controlled LED indicator.

FIGURE 1: **MODULE FRONT**



SPECIFICATIONS

Normal Operating Voltage: 15 to 30VDC Alarm Current: 2 5mA

1.8mA with 22k EOL (No EOL Standby Current:

resistor required when operated in Class A on load

side)

Max Fire Phone Wiring Resistance 150 Ohms Max NAC Wiring Resistance see Table 1 Max Speaker Wiring Resistance see Table 2 & 3 Temperature Range:

32°F to 120°F (0°C to 49°C) Humidity: 10% to 93% Non-condensing Dimensions: 4 5/8" H x 4 1/4" W x 1 1/8" D Mounting: 4" square by 2 1/8" deep box

double-gang box MIX-4090 Programmer

> BB-400 surface mounted backbox MP-302 EOL on mounting plate


Wiring range on all terminals: 22 to 12 AWG


MOUNTING

Notice: You must disconnect power from the system before installing the module. If this unit is being installed in a system that is currently operational, it is necessary to inform the operator and the local authority that the system will be temporarily out of service.

The MIX-4046 module is intended to be mounted in a standard 4" square back-box (see Figure 2) or double-gang electrical box. The box must have a minimum depth of 2 1/8 inches. Surface mounted electrical boxes (BB-400) are available.

FIGURE 2: **MODULE MOUNTING**

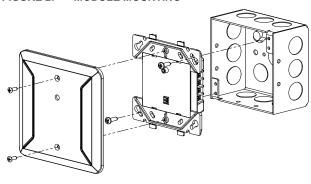



WIRING

Note: This device should be installed as per applicable requirements of the authorities having jurisdiction.

Use the programmer tool to set the address on the module as indicated on the job drawings.

CAUTION: To set the address on this device, disconnect it from the loop, or ensure that the loop to which it is connected is both disconnected from the panel and shorted across the SLC+ and SLCinputs at the device. Failing to take either of these steps may change the address programming of previously configured sensors on the

- Install the module wiring as indicated by the job drawings and appropriate wiring diagrams (see Figures 3 through 8 for examples of wiring different devices).
- Mount the module in the electrical box as shown in figure 2.

Note: The external power source must be Listed for use in Fire alarm systems. Power connection to the module must be monitored for integrity with built-in or external Listed end of line relay.

Accessories:

FIGURE 3: SAMPLE CLASS A FIRE PHONE WIRING:

MIX-4046 does not supervise supply circuit See fire phone supply installation documents for supervision requirements


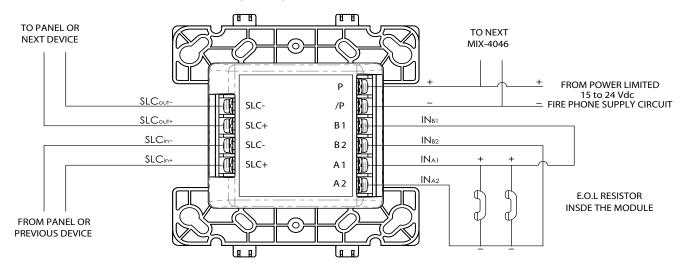


FIGURE 4: SAMPLE CLASS B FIRE PHONE WIRING:

MIX-4046 does not supervise supply circuit See fire phone supply circuit installation documents for supervision requirements

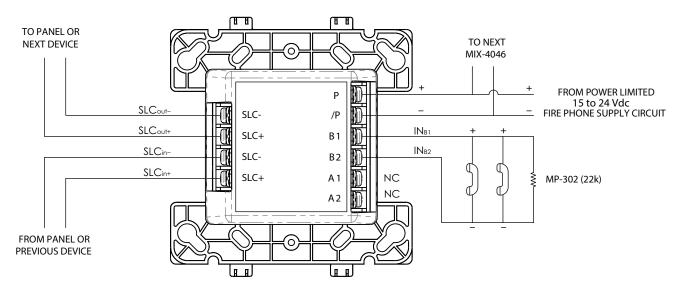

2 LT-6144 rev 2 2/18/25

FIGURE 5: SAMPLE CLASS A NAC WIRING

MIX-4046 does not supervise NAC supply line See NAC power supply installation documents for supervision requirements

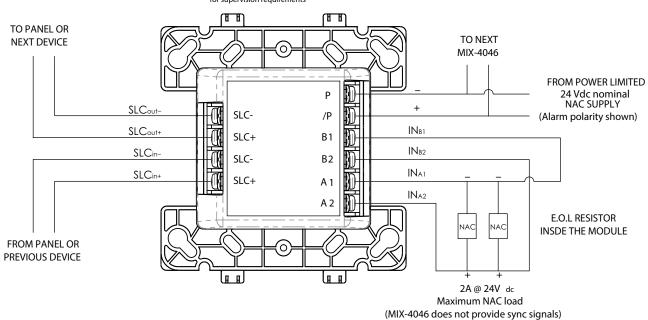


FIGURE 6: SAMPLE CLASS B NAC WIRING

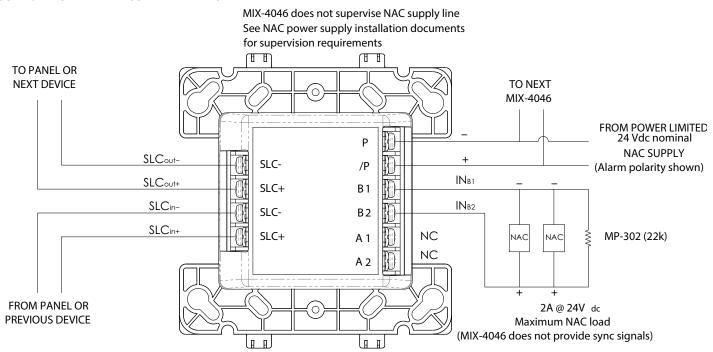


FIGURE 7: SAMPLE CLASS A SPEAKER WIRING

MIX-4046 does not supervise amplifier line See amplifier installation documents for supervision requirements


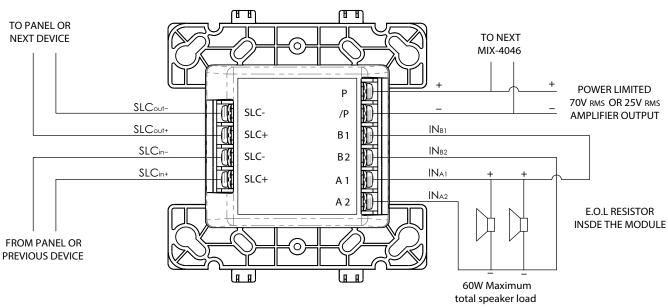


FIGURE 8: SAMPLE CLASS B SPEAKER WIRING

MIX-4046 does not supervise amplifier line See amplifier installation documents for supervision requirements

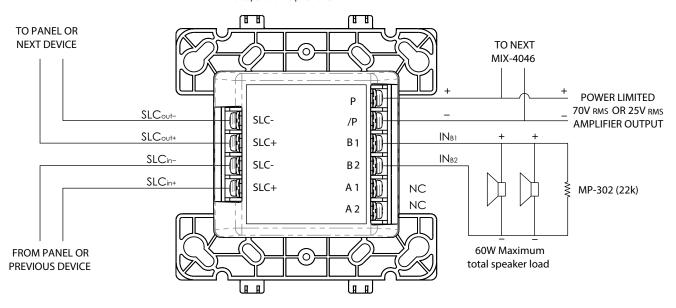

4 LT-6144 rev 2 2/18/25

Table 1, NAC wiring selection:

The total drop from the power supply output to the devices should not exceed 1.8V based on the use of NAC from Mircom FACPs. This includes the riser drop and the MIX-4046 device line drop. If the riser is connected to several MIX-4046, the total riser load current must be used to calculate drop. The following tables provide a useful approximation

Maximum riser length from power supply to last MIX-4046				
Riser current	#18AWG	#16AWG	#14AWG	#12AWG
500mA	210ft	335ft	535ft	850ft
	(64m)	(102m)	(163m)	(259m)
1A	105ft	165ft	265ft	425ft
	(32m)	(51m)	(82m)	(130m)
1.5A	70ft	110ft	175ft	280ft
	(21m)	(34m)	(54m)	(86m)
2A	50ft	80ft	130ft	210ft
	(16m)	(26m)	(41m)	(65m)
2.5A	40ft	65ft	105ft	170ft
	(13m)	(21m)	(33m)	(52m)

Maximum line length from MIX-4046 to last device with worst case riser loss				
Line current	#18AWG	#16AWG	#14AWG	#12AWG
100mA	350ft	560ft	890ft	1400ft
	(107m)	(171m)	(272m)	(432m)
250ma	140ft	220ft	355ft	565ft
	(43m)	(68m)	(109m)	(173m)
500ma	70ft	110ft	175ft	280ft
	(21m)	(34m)	(54m)	(35m)
1A	35ft	55ft	90ft	140ft
	(11m)	(17m)	(27m)	(43m)
2A	15ft	25ft	45ft	70ft
	(5m)	(9m)	(14m)	(22m)

Table 2, speaker line wire selection (70VRMS line)

The maximum voltage drop on a 70V line should not exceed 7V from the amplifier to the last speaker to limit power loss to 1dB. The following tables provide a useful approximation.

Maximum riser length from amplifier to last MIX-4046				
Riser Wattage	#18AWG	#16AWG	#14AWG	#12AWG
15W	1900ft	3000ft	4900ft	7700ft
	(584m)	(929m)	(1479m)	(3135m)
30W	950ft	1525ft	2425ft	3850ft
	(290m)	(460m)	(740m)	(1175m)
60W	480ft	760ft	1210ft	1925ft
	(145m)	(230m)	(370m)	(585m)

Maximum line length from MIX-4046 to last speaker with worst case riser loss				
#18AWG	#16AWG	#14AWG	#12AWG	
1275ft	2030ft	3235ft	5140ft	
(390m)	(620m)	(986m)	(1570m)	
640ft	1015ft	1615ft	2570ft	
(195m)	(310m)	(493m)	(784m)	
320ft	505ft	805ft	1285ft	
(97m)	(155m)	(247m)	(392m)	
	#18AWG 1275ft (390m) 640ft (195m) 320ft	#18AWG #16AWG 1275ft 2030ft (390m) (620m) 640ft 1015ft (195m) (310m) 320ft 505ft	#18AWG #16AWG #14AWG 1275ft 2030ft 3235ft (390m) (620m) (986m) 640ft 1015ft 1615ft (195m) (310m) (493m) 320ft 505ft 805ft	

Table 3, speaker line wire selection (25VRMS line)

The maximum voltage drop on a 25V line should not exceed 2.5V from the amplifier the last speaker to limit power loss to 1dB. The following tables provide a useful approximation.

Riser Wattage	#18AWG	#16AWG	#14AWG	#12AWG
15W	245ft	390ft	615ft	980ft
	(75m)	(120m)	(190m)	(300m)
30W	120ft	195ft	310ft	490ft
	(37m)	(60m)	(94m)	(150m)
60W	60ft	95ft	155ft	245ft
	(19m)	(30m)	(47m)	(75m)

Line Wattage	#18AWG	#16AWG	#14AWG	#12AWG
7.5W	165ft	300ft	410ft	655ft
	(50m)	(79m)	(126m)	(200m)
15W	80ft	130ft	205ft	330ft
	(25m)	(40m)	(63m)	(100m)
30W	40ft	65ft	100ft	165ft
	(12m)	(20m)	(31m)	(50m)