


Installing the BBX-FXMNS-6000 Enclosure

This enclosure will accommodate the Flex-Net™ FX-MNS-6000 Network Fire Alarm and Emergency Communication System.

The BBX-FXMNS-6000 enclosure includes a backbox, an inner door and an outer door. The enclosure is surface mounted using the four mounting holes.

Figure 1: BBX-FXMNS-6000 Dimensions, Mounting Holes and Knockouts for Installation

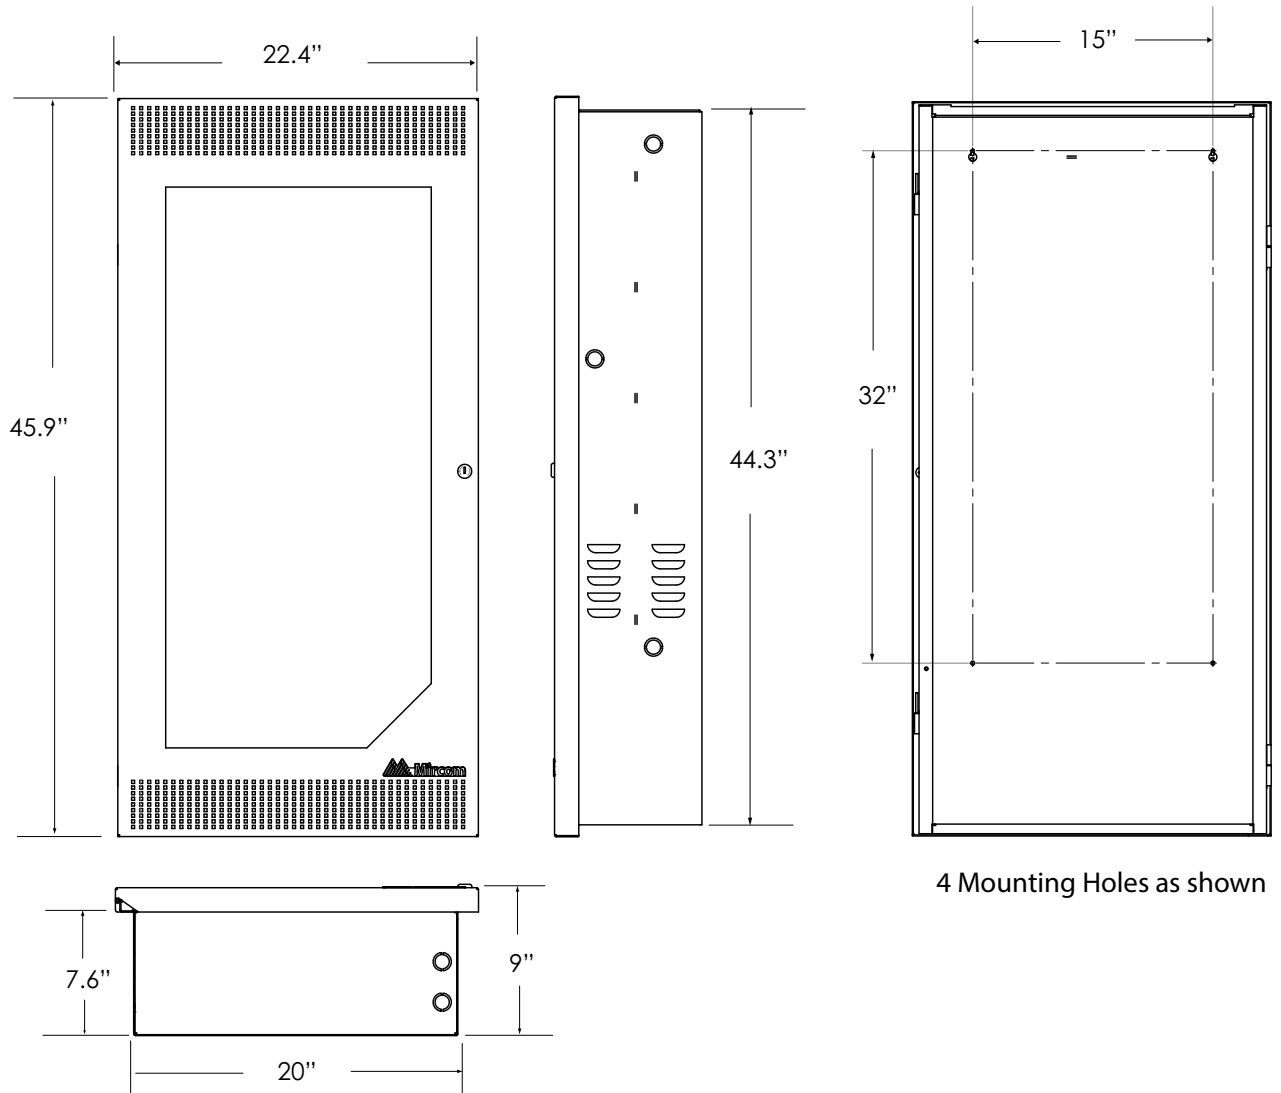

Attach Label to Inner Door

To comply with CAN/ULC-S527, attach the included warning label to the inner door over the keyhole. Align the top edge of the label with the bottom of the opening in the door, as shown below.

Figure 2: Attach the label to the inner door

